

# Hydrogen Energy Systems as a Grid Management Tool

**Mitch Ewan**

**Hawaii Natural Energy Institute**

**School of Ocean and Earth Science and Technology**

**University of Hawaii**

**2018 NELHA Energy Storage Conference**

**December 6, 2018**


# Grid Frequency Management

- ✓ Electric power grids operate at a frequency of 60 Hz;
- ✓ Deviation from 60 Hz is a measure of the load balance of the grid – load matched to generation;
- ✓ With increased penetration of intermittent renewables on the grid the supply and grid frequency may be subject to fluctuations;
- ✓ Grid operators can stabilize the frequency by ramping power generation up/down or controlling variable loads or storage;
- ✓ **Project Thesis: An electrolyzer can be used as a variable controllable load that can be reduced/increased in order to maintain the total load balance and frequency stability.**

# Project Objectives

- ✓ **Validate the performance, durability & cost benefits of grid integrated hydrogen systems;**
  - **Demonstrate dynamic operation of electrolyzers to mitigate impacts of intermittent renewable energy;**
  - **Demonstrate potential of multiple revenue streams from monetization of ancillary services and producing hydrogen;**
  - **Supply hydrogen to shuttle buses operated by County of Hawaii Mass Transit Agency (MTA), and Hawaii Volcanoes National Park (HAVO);**
- ✓ **Support development of regulatory structure for permitting and installation of hydrogen systems in Hawaii.**


# Concept

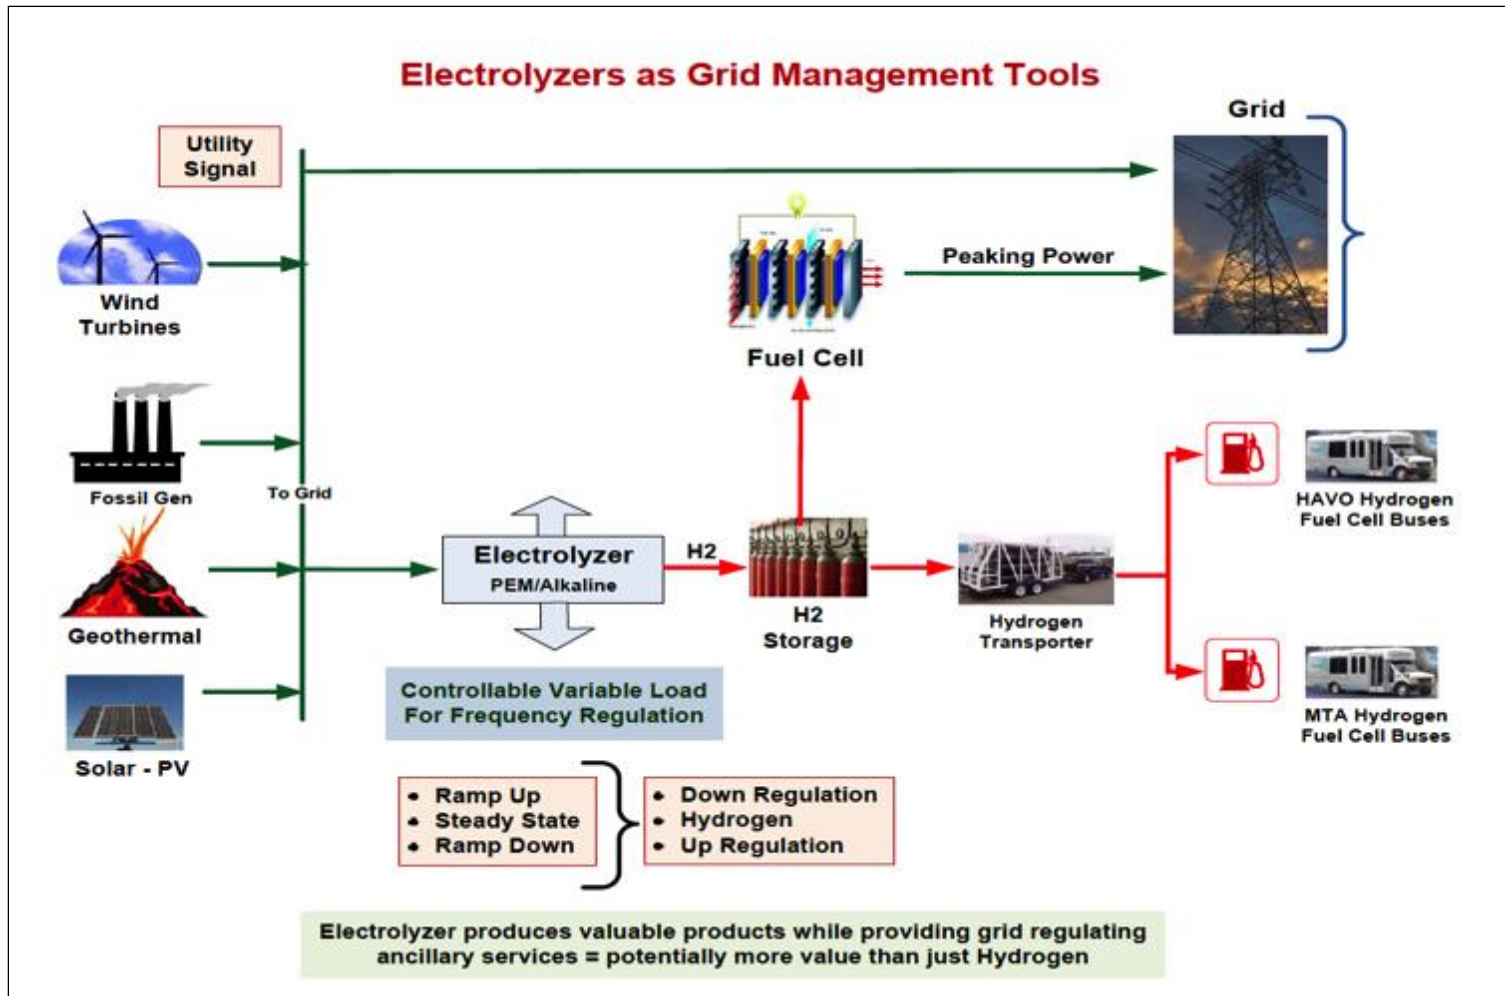

HNEI's concept to use an electrolyzer to provide grid ancillary services such as up-regulation, down-regulation, and off-peak load.


# Central Site Production/Distributed Dispensing

**Economically viable electrolytic hydrogen will require low cost electricity + high capital utilization.**

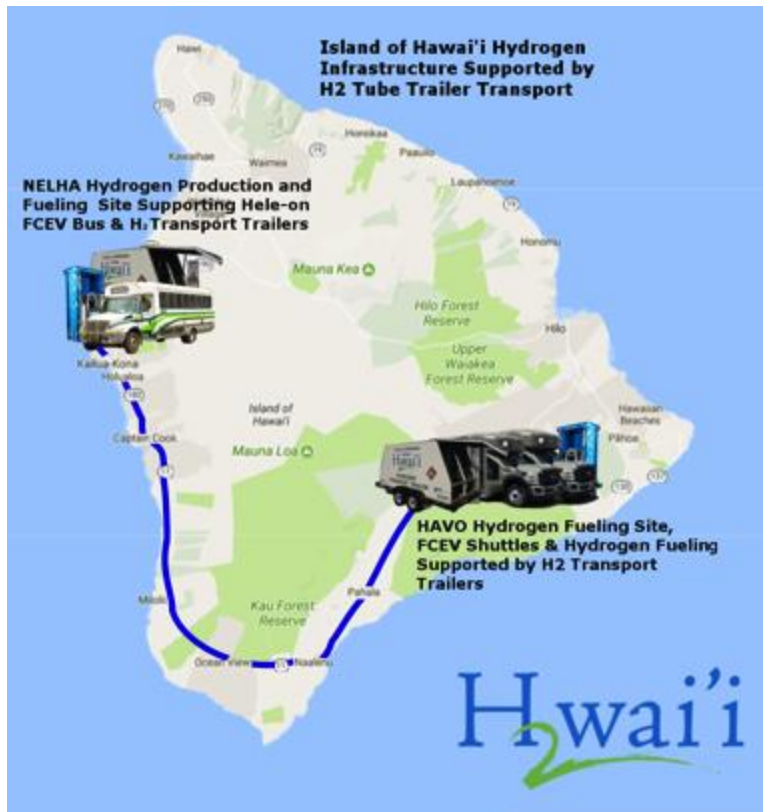

- ✓ **Central site production for highest capital utilization;**
- ✓ **Distributed dispensing sites with minimum complexity to reduce fuel distribution costs;**
- ✓ **Optimize additional revenue streams from:**
  - **Quantify and monetize ancillary services;**
  - **Sale of hydrogen for transportation.**

# Use of Electrolyzer for Grid Ancillary Services

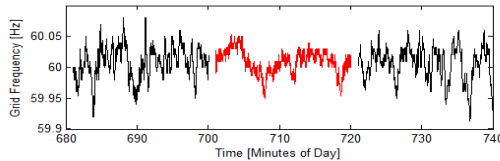

**Grid Frequency (Hz): Measured with battery off (black) and on (red) at twenty (20) minute intervals**

- **HNEI demonstrated ability to regulate grid frequency on 150MW grid with a fast-acting 1MW battery;**
- **Cycling tests suggest electrolyzer more appropriate for slower-acting changes;**
- **Battery/electrolyzer hybrid may provide grid services across broad range of operating conditions;**
- **Using electrolyzer as a variable load as opposed to battery allows effective use of CAPEX plus other value added services.**

# Central Site Production Located at NELHA

- **State of Hawaii facility:**
  - Strong political & financial support;
  - Significant cost share provider;
  - Leverages available technical staff.
- **Ease of permitting;**
- **Existing infrastructure reduces site costs;**
- **Kona Airport offers opportunity to leverage project:**
  - Airport ground handling equipment;
  - Airport shuttle buses;
  - Rental cars.
- **Supports NELHA Vision of a “Hydrogen Hub”;**
  - Provides **“enabling”** infrastructure to attract new projects.

# NELHA Hydrogen Site Layout





# Site Preparation



## Excavation



## Concrete Pad

# Equipment Installation



**Setting Equipment  
20-ton Lift**

# Site Work Completed



# Site Work Completed





# Tube Trailer Filling Bays



# Dispenser



# Converted 3 Fuel Cell Electric Hybrid Buses



County of Hawaii Bus (1) 29 Pass



HAVO Bus (2) 19 Pass

- **Hawaii MTA Fuel Cell Electric Hybrid Shuttle Buses demonstrate to the general public the advantages of fuel cell buses and electric drive.**
  - **Quiet ride;**
  - **No diesel fumes;**
  - **Potential for lower O&M costs (need low cost hydrogen).**
- **HAVO Buses will demonstrate HNEI's "Smart" air filtration sensor systems in a high air contaminant environment.\***  
**(Funded by ONR).**

# Recertified 3 Hydrogen Transport Trailers



- **Hydrogen Transport Trailer carries 105 kg @ 450 bar;**
- **Demonstrate distributed dispensing using cascade fill to 350 bar using a “Smart” dispenser;**
- **Trailer O&M costs will be evaluated including US DOT hydrostatic testing requirement every 5 years;**
  - **Currently no facility in Hawaii can hydro test cylinders of this size;**
  - **Must be shipped to mainland (very costly and time consuming);**
  - **Recertified Trailers before shipping to Hawaii to give us a full 5-year window.**



# Collaborations

- ✓ US Department of Energy: **Project Sponsor & Funding;**
- ✓ Naval Research Laboratory: **Federal Technical Program Manager;**
- ✓ Hawaii Natural Energy Institute: **Implementing Partner, Technical Lead;**
- ✓ Office of Naval Research: **Supplemental Funding;**
- ✓ State of Hawaii - HSDC: **Public Outreach, Significant Cost Share;**
- ✓ Natural Energy Laboratory Hawaii Authority: **Host Site; Site Work, Cost Share**
- ✓ County of Hawaii MTA: **Host Site, Bus Operator (Cost Share);**
- ✓ Hawaii Volcanoes National Park: **Host Site, Bus Operator;**
- ✓ HCATT: **Conversion of Shuttle Bus, Cost share;**
- ✓ US Hybrid: **Conversion of Shuttle Bus, Cost share;**
- ✓ HELCO: **Interested Observer, Potential Partner for Grid Analysis;**
- ✓ Hydrogen Safety Panel: **Design Hydrogen Safety Review;**
- ✓ PNNL: **First Responder Training (Cost Share);**
- ✓ Boyd Hydrogen: **Site Hydrogen Safety Review, Permitting Department Workshop.**
- ✓ Proton Onsite: **Electrolyzer Control System**
- ✓ Aloha Petroleum: **Hydrogen Delivery**